


Cut-off valve requirement as specified in "An Ordinance Regulating the Use of Water and Sewer Facilities operated by the County of Harnett, Section 32" and authorized by the Harnett County Board of Commissioners, September 6, 1994

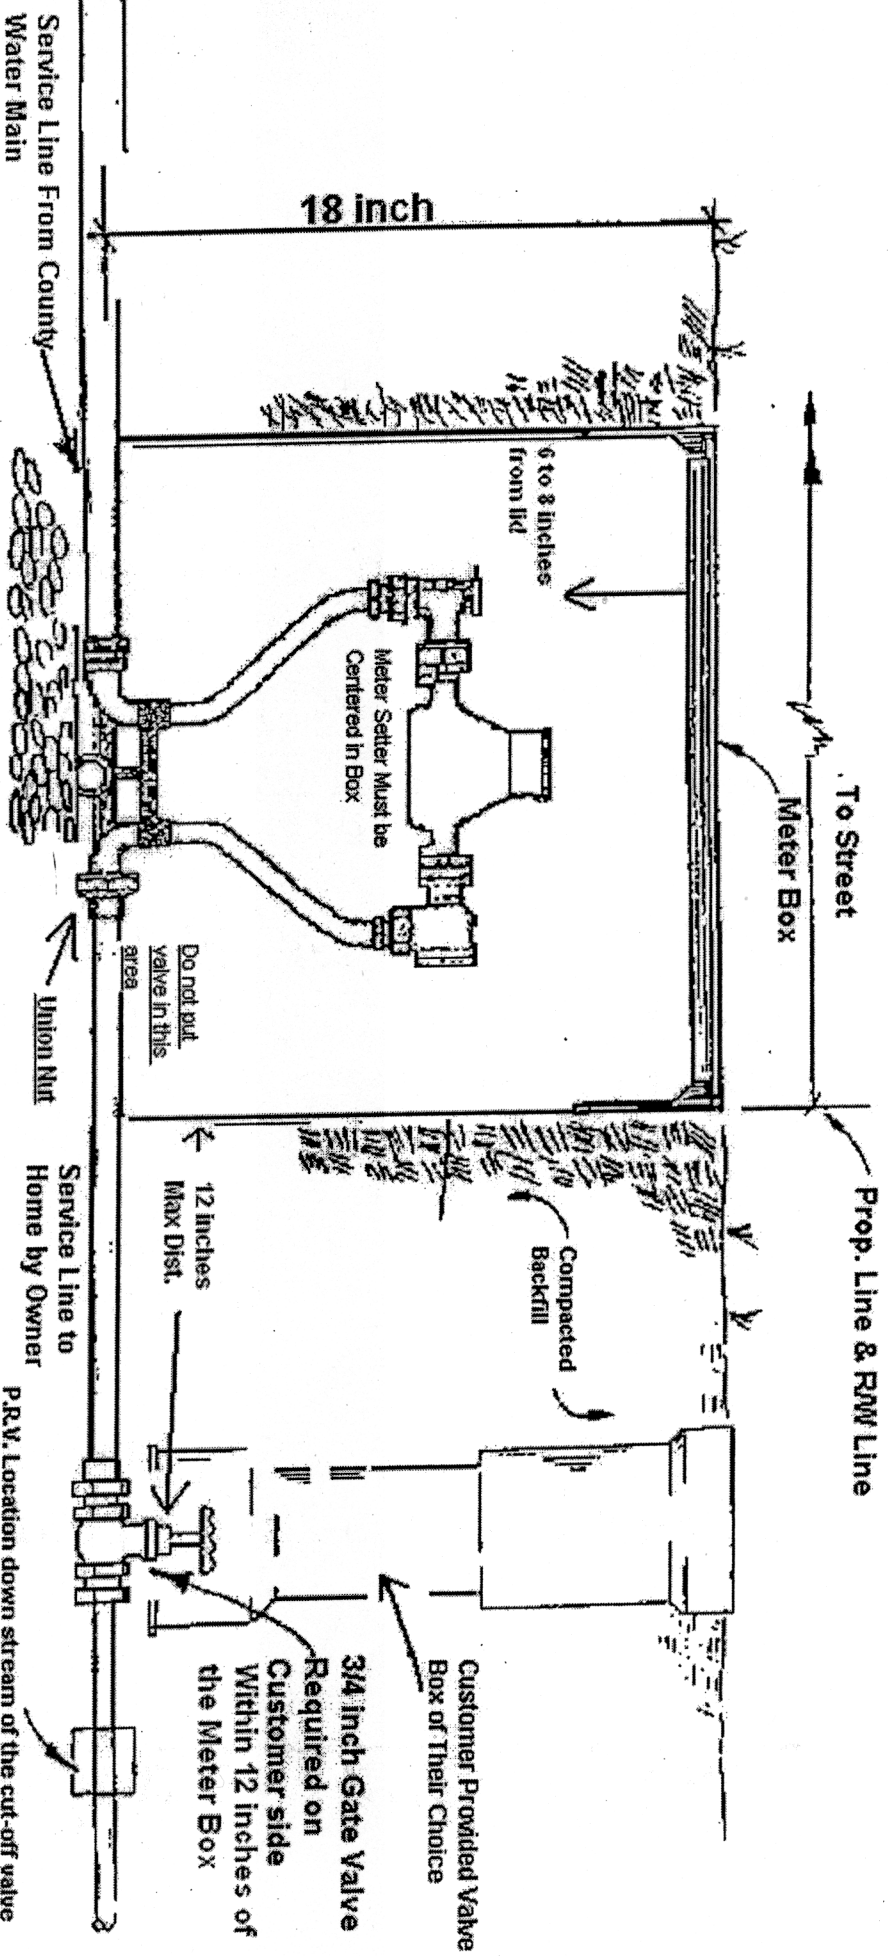

Typical Meter Box Installation

Not to Scale


The Meter will not be installed if the setter is not centered in the meter box, the setter has been pulled up on one end, the setter is laying on its side, the setter is too close to the box lid, the box is bellow grade or broken, the customers service line is not hooked to the union nut, the 3/4 gate valve has not been installed within 12 inches of the meter box.

The Meter Box must have easy access at all times.

Do not plant bushes within 4 feet of the meter box.

Do not install a fence where the meter box will be inside.

The customer is responsible for leaks at the union nut and their service line.

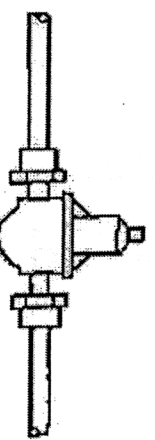

Optional Pressure Reducing Valve
(Better Location under Home)

Notice on cut off valves.

Per Harnett County Rules and Regulations,
meters will be installed in new services
only
if the customer has installed
a separate box for their cut off valve.

Cut off valves installed inside the meter box
will not be issued a meter
until this has been corrected.

Please be sure your cut off box is installed
according to the installation handout
before requesting your meter.
Second trips to install meters can be
charged a service fee.